

NOTE:


1. CONCRETE ENCASE ENTIRE WYE SECTION AND 45° BEND IF CONCRETE PIPE.
2. STAND PIPE TO BE SAME SIZE AS MAINLINE UP TO AND INCLUDING 8" PIPE. MAINLINE GREATER THAN 8" SHALL HAVE A 8" STANDPIPE.

STANDARD CLEANOUT

DRAWING NO. 500


REVISED 01-13



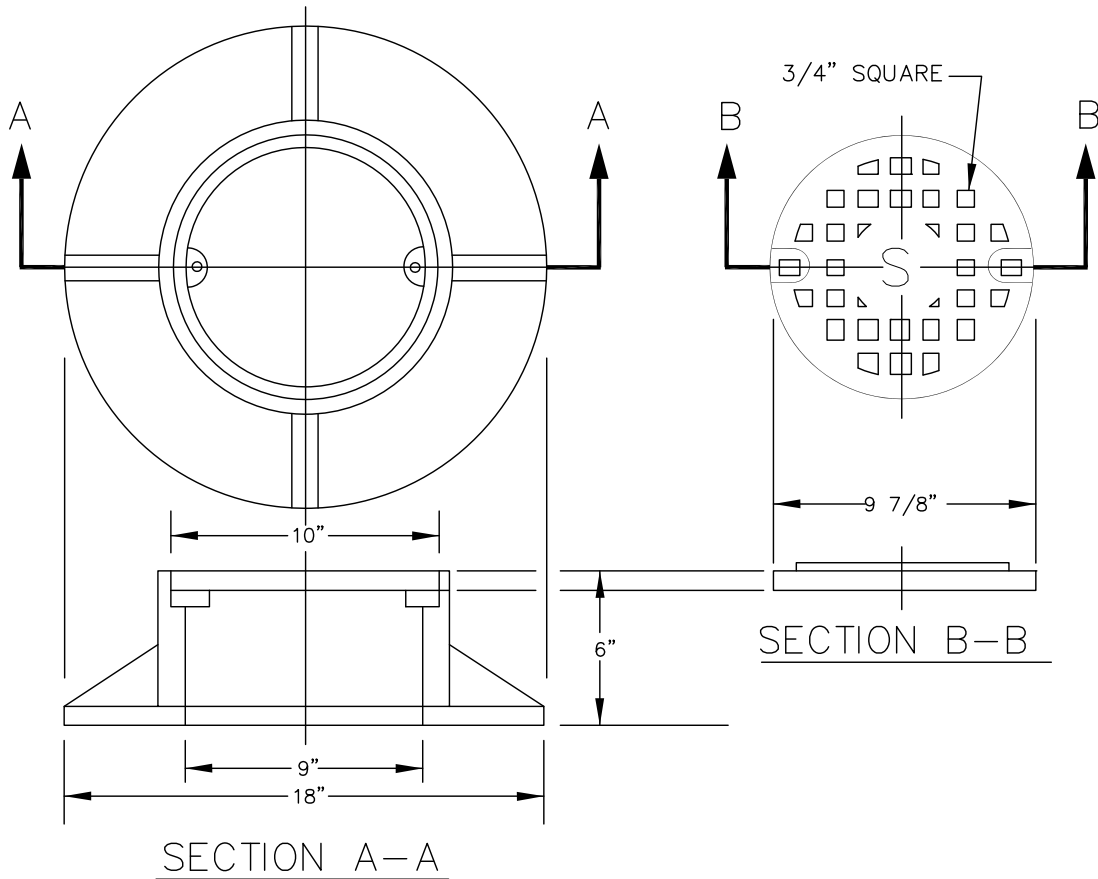

NOTES

1. 1/4" ALLEN HEAD BOLTS
1" LONG RECESSED.
2. ALL PERMANENT CLEANOUTS
TO HAVE BOLT DOWN COVERS.
3. MATERIAL SHALL BE GRAY
CAST-IRON, ASTM A-48,
CLASS 30.

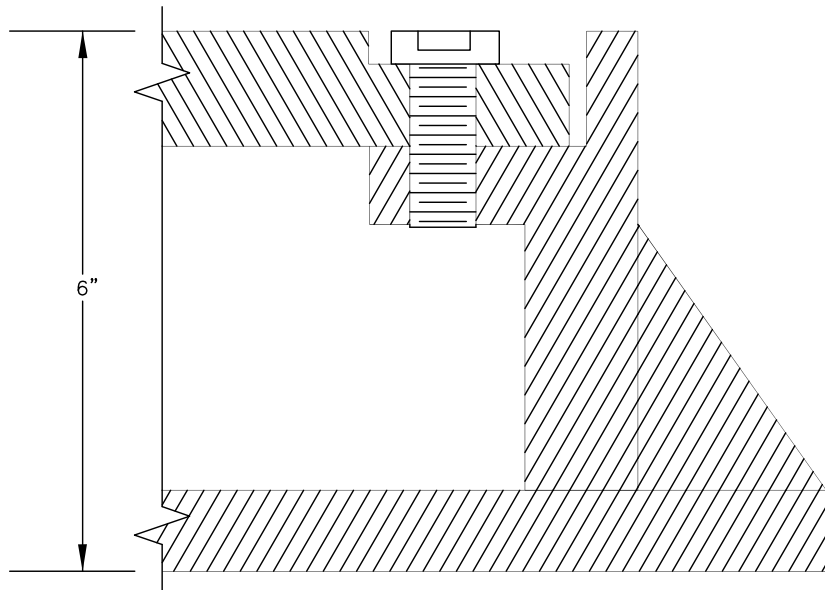


CLEANOUT FRAME
AND COVER


DRAWING NO. 510

REVISED 12-16




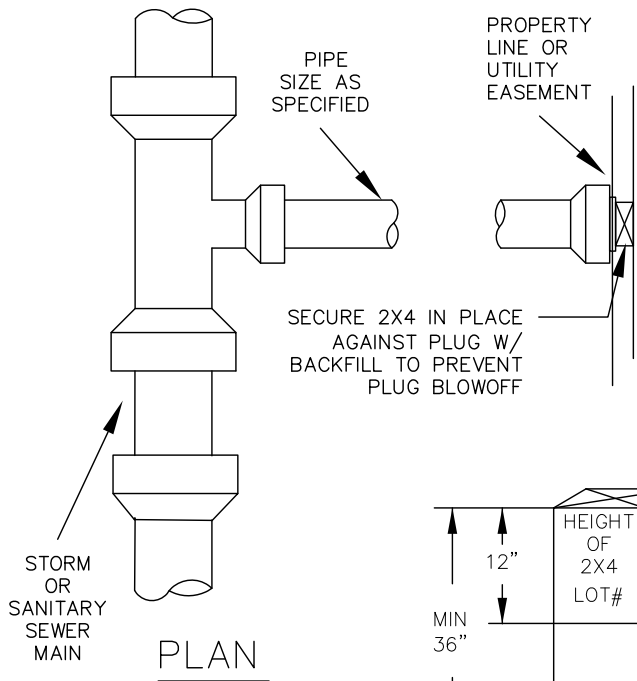

1. ALL STORM AND SANITARY SERVICE LATERALS SHALL BE MARKED ON THE TOP FACE OF CURB AS FOLLOWS:
 - STORM DRAIN LATERALS "D"
 - SANITARY SEWER LATERALS "S"
2. LETTERS SHALL HAVE 1/2" MAX. WIDTH AND A MAX HEIGHT OF 4"
3. LETTER SHALL BE CENTERED ON TOP FACE OF CURB.




CURB STAMP DETAIL

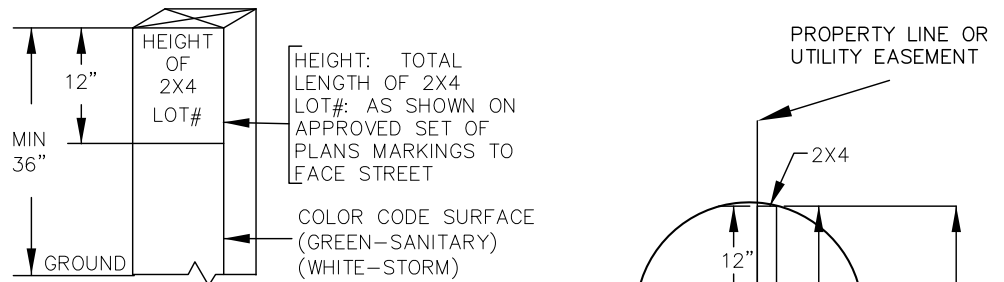

NOTES:

1. FOR NEW CONSTRUCTION ALL SIDE SEWER AND SIDE STORM PIPELINE CONNECTIONS TO 8" AND 10" MAINS SHALL BE WITH FACTORY FABRICATED "TEE" FITTINGS UNLESS OTHERWISE APPROVED.
2. PIPE MATERIAL SHALL BE ONE OF THE FOLLOWING
 - A. PVC ASTM-D3034, ASTM-C900
 - B. DUCTILE IRON CLASS-50
 (STORM ONLY)
 - C. A-2000 PVC ASTM 949
 - D. PVC RIB MEETING ASTM D 1784
 - E. CPP MEETING AASHTO M252

LABEL MAGNETIC TAPE WITH BLACK LETTERING STATING THE FOLLOWING:
 FOR SANITARY: "CAUTION SEWER BURIED BELOW."
 FOR STORM: "CAUTION STORM DRAIN BURIED BELOW."
 PLACE 18" ABOVE TOP OF PIPE AND AGAINST 2X4.

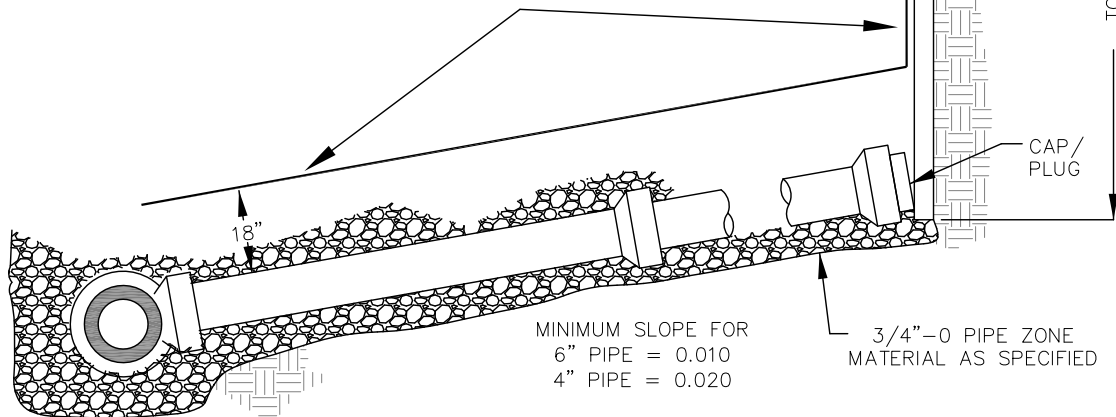


MINIMUM SLOPE FOR
 6" PIPE = 0.010
 4" PIPE = 0.020


ELEVATION

SIDE SEWER / SIDE STORM
 PIPELINE







1. PVC HUB SHALL CONFORM TO ASTM 3034, SDR 35 DRIVE INTO CENTER OF RUBBER SLEEVE AFTER SLEEVE IS PLACED IN HOLE.



2. STAINLESS STEEL BAND SECURES UPPER HALF OF RUBBER SLEEVE TO THE PVC HUB. STAINLESS STEEL BAND SHALL BE 300 SERIES, $\frac{9}{16}$ " BAND WIDTH, CADMIUM PLATED CARBON STEEL, AND ATTACHED WITH HEX HEAD SLOTTED SCREW.



3. COMPLETE RUBBER SLEEVE INCLUDES A MOLDED SEGMENT THAT HOLDS IT IN PLACE.

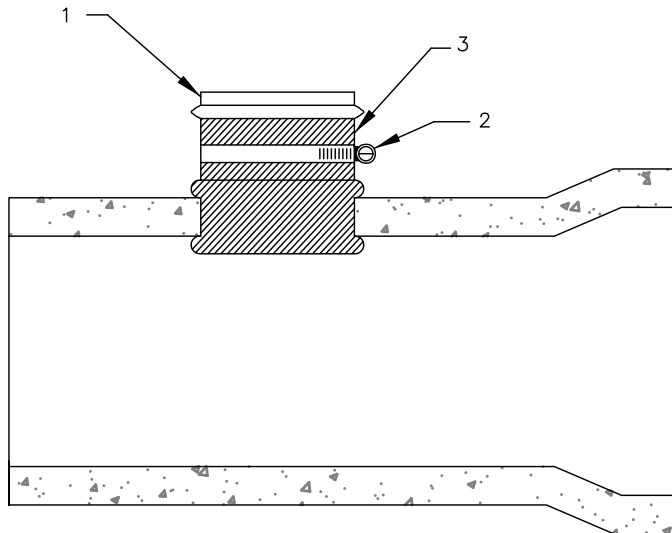


NOTES:

1. ALL INSERTA-TEE HOLES SHALL BE MACHINE DRILLED AND CORED.
2. INSERTA-TEES ARE NOT ALLOWED IN NEWLY CONSTRUCTED SEWER MAINS WITH AN INSIDE DIAMETER (I.D.) OF 10 INCHES OR SMALLER.
3. SEWER MAIN SHALL BE TWO SIZES (NOMINAL I.D.) LARGER THAN THE INSERTA-TEE.


INSERTA-TEE



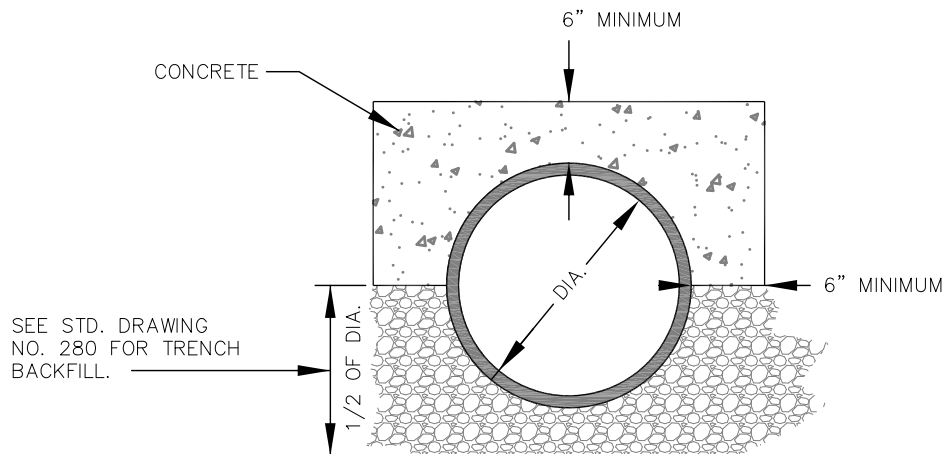



END VIEW

NOTE:
 CONCRETE SHALL HAVE A 28
 DAY STRENGTH OF 3000 PSI
 AND 2" TO 4" SLUMP.

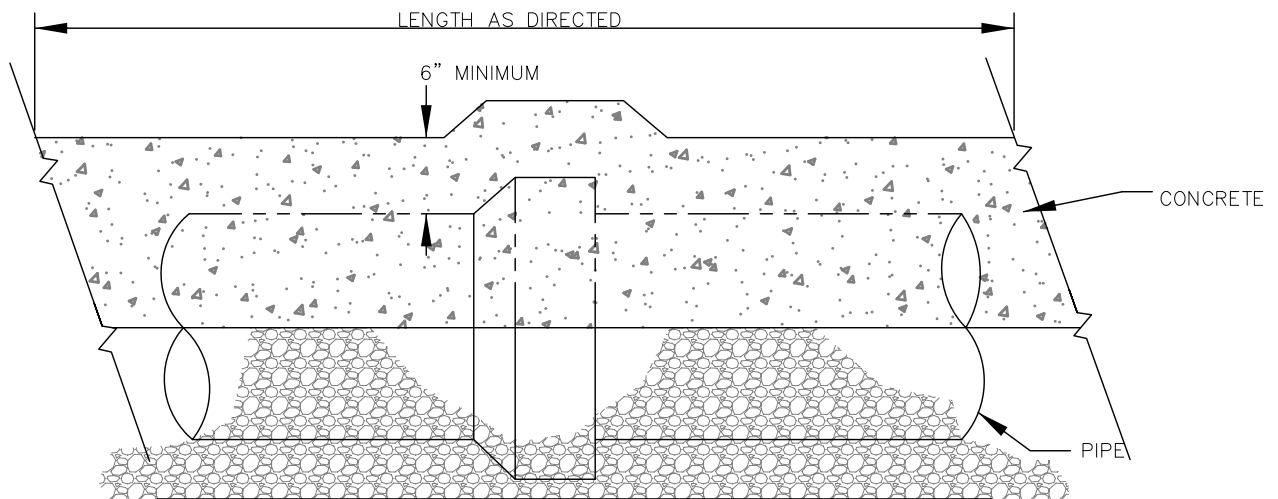

SIDE VIEW

CONCRETE CAP

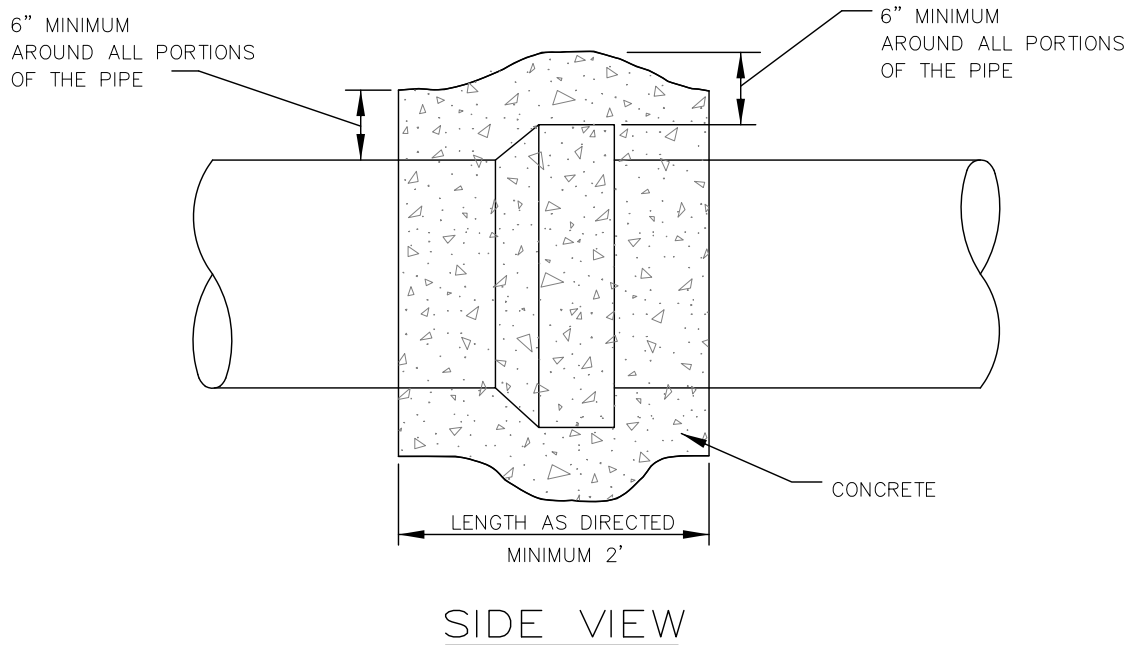
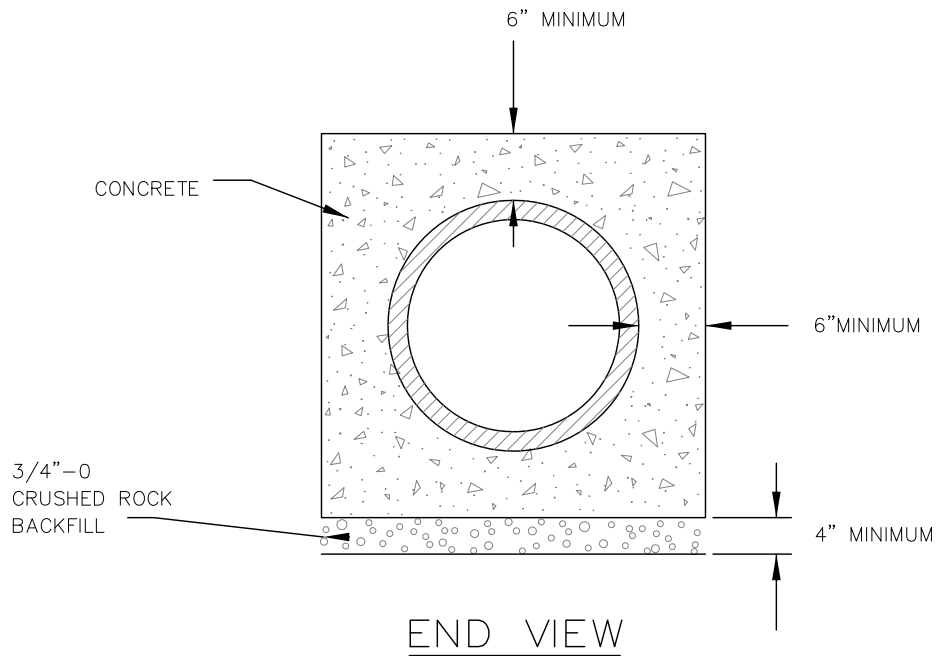


NOTE:

1. CONCRETE SHALL HAVE A 28 DAY STRENGTH OF 3000 PSI AND, 2" TO 4" SLUMP.
2. PRIOR TO INSTALLING THE CONCRETE ENSURE THE JOINT IS SEAL IN A MANNER AS NOT TO ALLOW CONCRETE TO ENTER INTO THE INTERIOR OF PIPE.

CONCRETE ENCASEMENT/ CLOSURE COLLAR



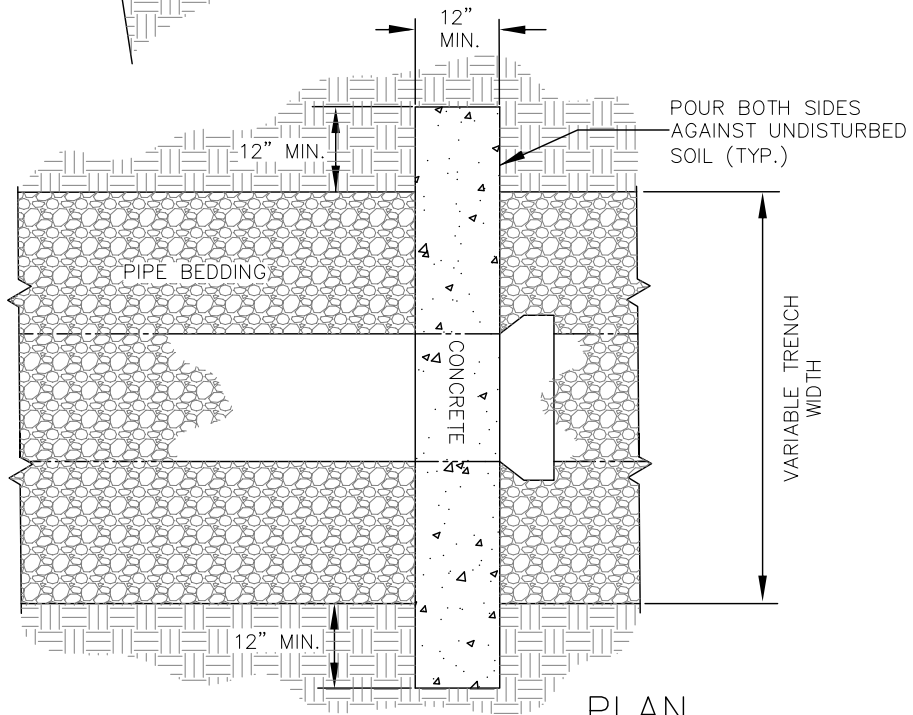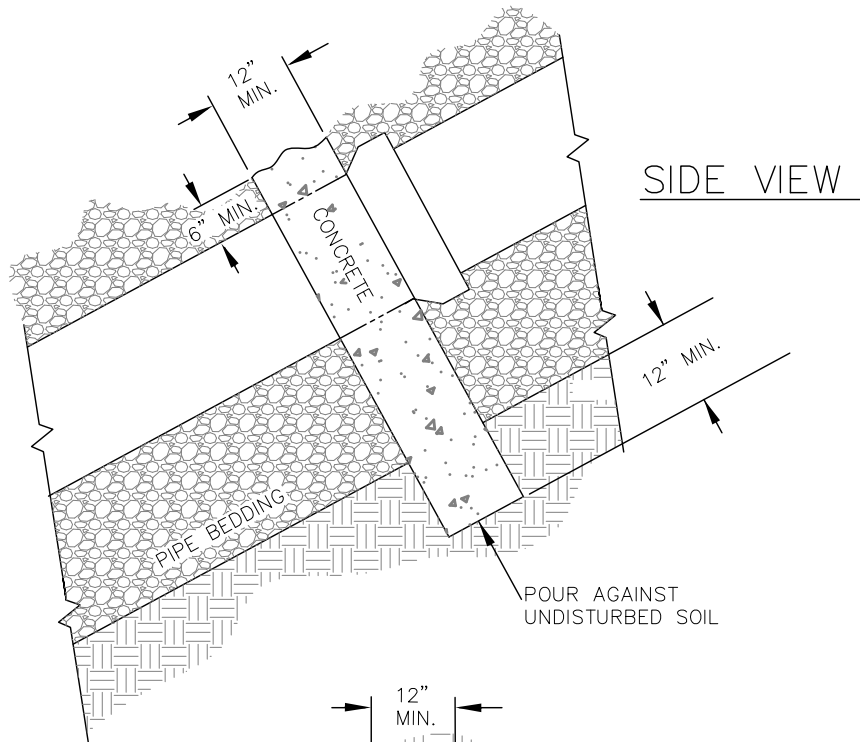


SLOPE	MIN. ANCHOR SPACING CENTER TO CENTER
20% - 34%	35'
35% - 50%	25'
51% +	15' OR CONC. ENCASEMENT

NOTE:


1. CONCRETE ANCHORS TO BE INSTALLED IMMEDIATELY DOWNHILL OF PIPEBELL.
2. CONCRETE SHALL HAVE A 28 DAY STRENGTH OF 3000 PSI, AND 2" TO 4" SLUMP.
3. ODOT "METAL PIPE SLOPE ANCHORS" ARE AN ACCEPTABLE ALTERNATIVE, SEE DETAIL #580.

CONCRETE ANCHOR WALL




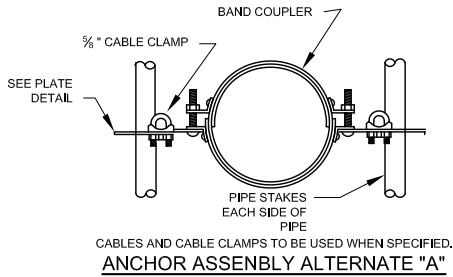


CABLES AND CABLE CLAMPS TO BE USED WHEN SPECIFIED.
ANCHOR ASSEMBLY ALTERNATE "A"



U BOLT



DETAIL "A"

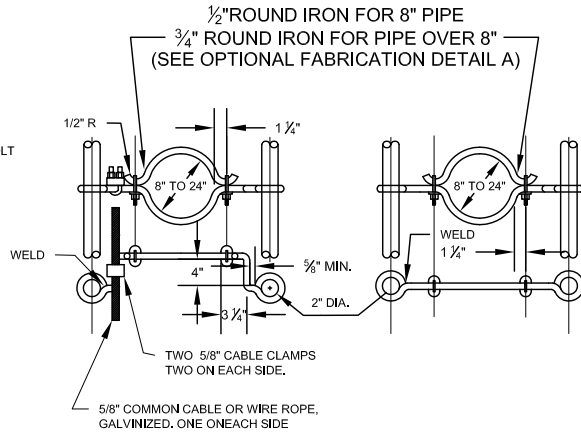

WITH CABLE **WITHOUT CABLE**
ANCHOR ASSEMBLY ALTERNATE "B"
CABLES AND CABLE CLAMPS TO BE USED WHEN SPECIFIED.


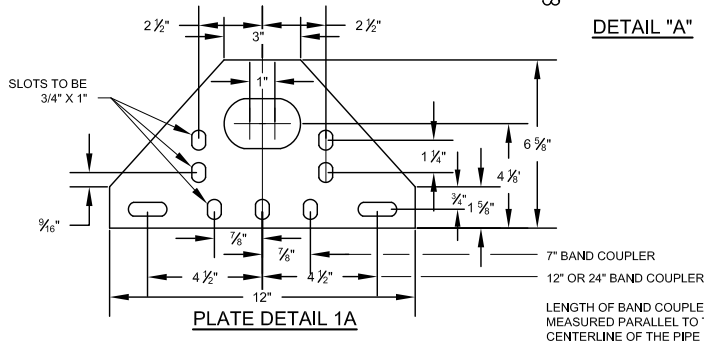


PLATE DETAIL 1A

LENGTH OF BAND COUPLER MEASURED PARALLEL TO THE CENTERLINE OF THE PIPE

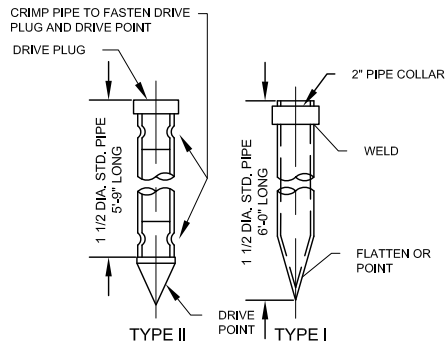

PIPE STAKES



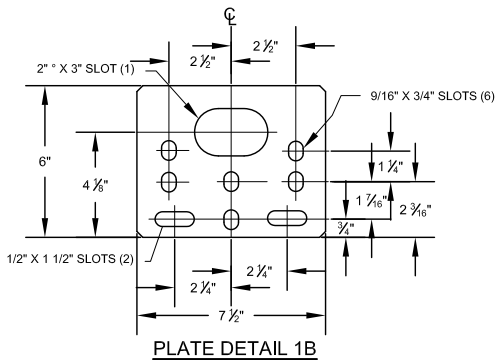


PLATE DETAIL 1B



DRIVE POINT
(CAST IRON)



DRIVE PLUG
(CAST IRON)

1. ALL PIPE STAKES AND HARDWARE TO BE GALVANIZED AFTER FABRICATION.
2. EITHER ALTERNATE "A" OR ALTERNATE "B" ANCHOR ASSEMBLY MAY BE USED AT CONTRACTOR'S OPTION FOR ANNULARLY CORRUGATED PIPE. ALTERNATE "A" TO BE USED WITH HELICALLY CORRUGATED PIPE.
3. EITHER TYPE 1 OR TYPE 2 PIPE STAKES MAY BE USED WITH EITHER ANCHOR ASSEMBLY ALTERNATE AT THE CONTRACTOR'S OPTION.
4. PLACE SLOPE ANCHOR ASSEMBLIES ON 6 M MAX. CENTERS. ON SLOPES 20 % OR GREATER.
5. PLATE MATERIAL TO BE ASTM A36M 6.3 MM GALVANIZE AFTER FABRICATION.

O.D.O.T. PIPE SLOPE ANCHOR

DRAWING NO. 580

REVISED 12-16




CLASS "B"

CLASS "A"

SURFACE RESTORATION
AS SPECIFIED

SEE STD
DRAWING 600
T-CUT ASPHALT
DETAIL

MOUND EXCESS NATIVE MATERIAL
OVER TRENCH TO ALLOW FOR
SETTLEMENT

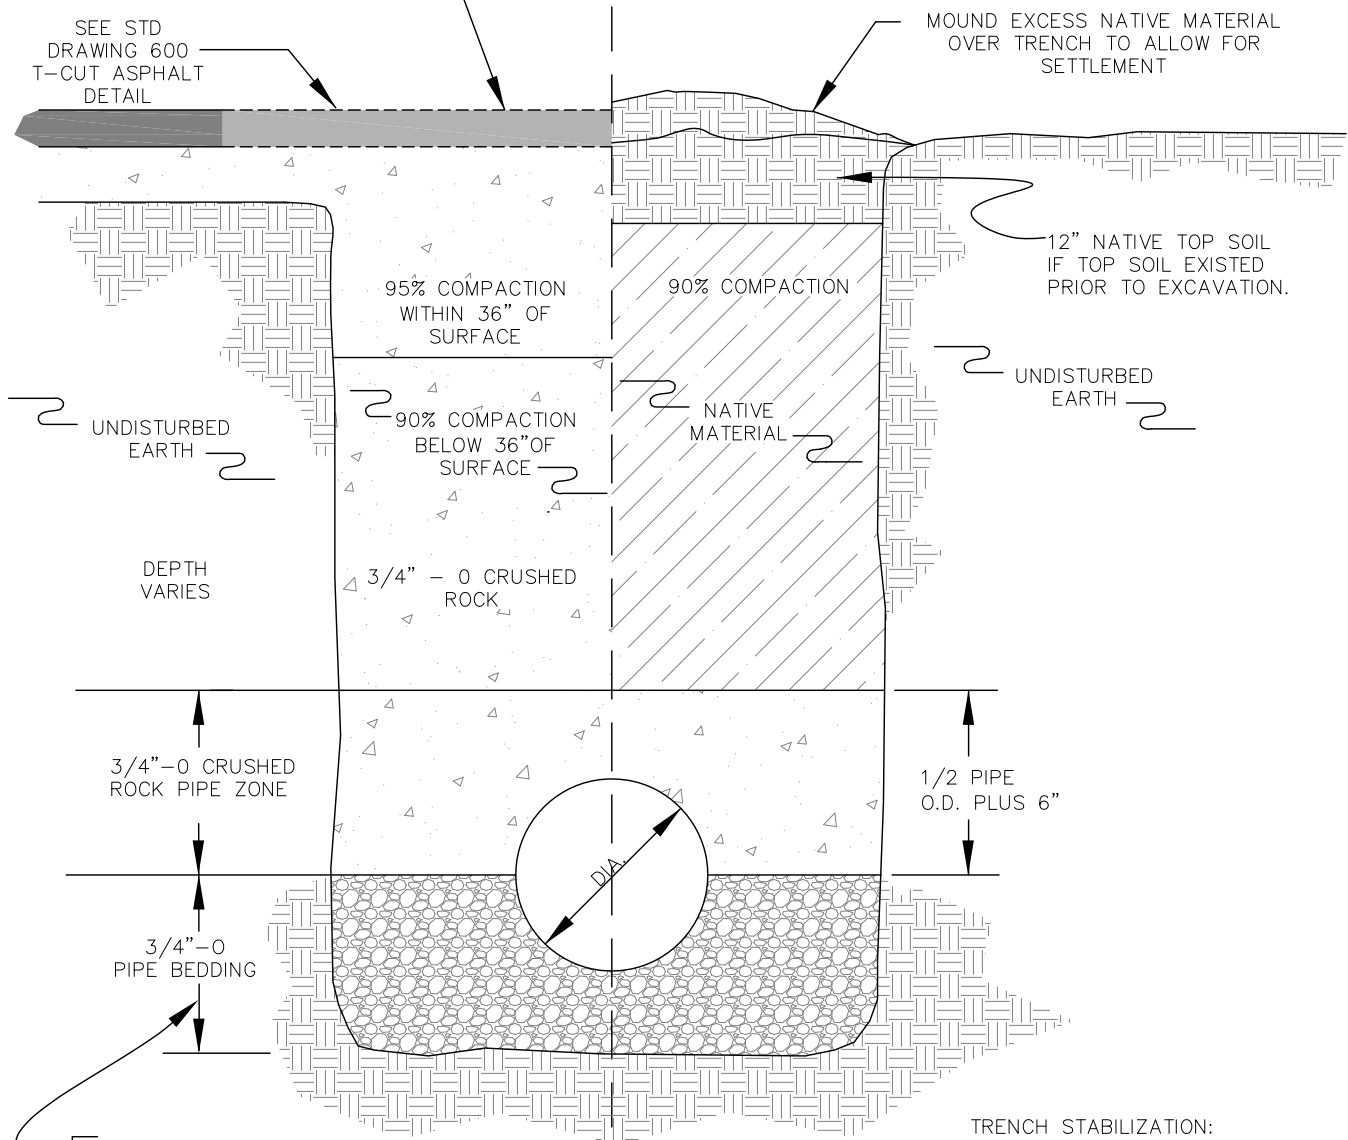

UNDISTURBED
EARTH

UNDISTURBED
EARTH

DEPTH
VARIES

3/4" - 0 CRUSHED
ROCK PIPE ZONE

3/4" - 0
PIPE BEDDING

1/2 PIPE
O.D. PLUS 6"

1/2 PIPE O.D. PLUS 4" MIN. FOR PIPE SMALLER THAN 18"
1/2 PIPE O.D. PLUS 6" MIN. FOR PIPE 18" AND LARGER

TRENCH STABILIZATION:
IF REQUIRED, TRENCH STABILIZATION
SHALL BE SPECIFIED SEPARATELY
AND PLACED PRIOR TO PLACEMENT
OF BEDDING MATERIAL.


NOTE:

1. ALL COMPACTION REQUIREMENTS PER AASHTO T-99 AND ODOT/APWA SPEC 00405.
2. THE TRENCH WIDTH AT THE SURFACE OF THE GROUND SHALL BE KEPT TO A MINIMUM NECESSARY TO INSTALL THE PIPE IN A SAFE MANNER.
3. THE MINIMUM TRENCH WIDTH IN THE PIPE ZONE SHALL PROVIDE A CLEAR WORKING SPACE OF SIX INCHES OUTSIDE THE MAXIMUM OUTSIDE DIAMETER OF THE PIPE BEING INSTALLED.
4. IN ALL CASES, TRENCHES SHALL BE OF SUFFICIENT WIDTH TO ALLOW FOR SHORING, PROPER JOINING OF PIPE, AND BACKFILLING OF MATERIAL ALONG THE SIDES OF THE PIPE.

TRENCH BACKFILL DETAILS



TACK ALL EXPOSED MATERIAL.
 PATCH AC TO GREATER OF 3"
 THICKNESS OR EXISTING.

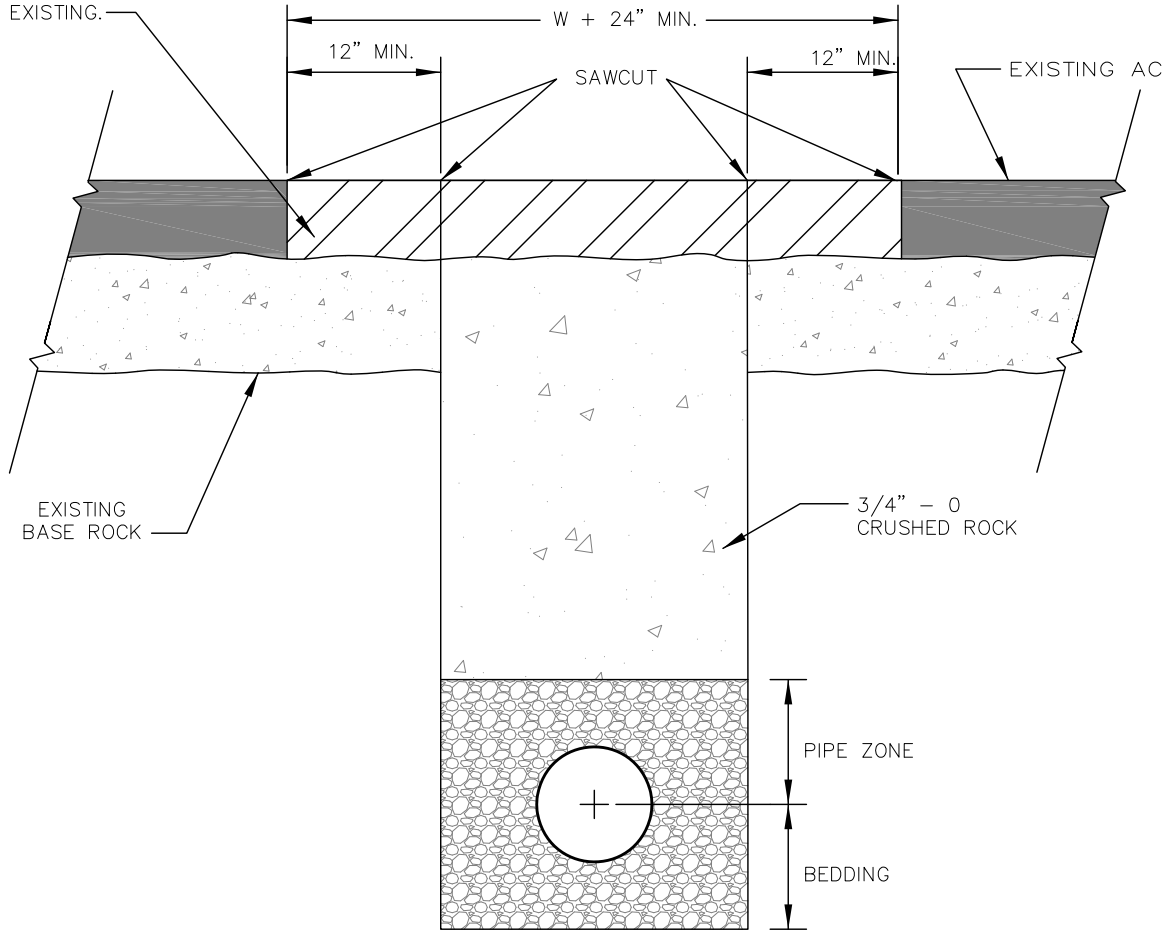

NOTE:

1. TEE CUT TO BE DONE AFTER EXCAVATION AND BACKFILL OF TRENCH.
2. SEE STD. DRAWING NO. 590 FOR BEDDING, PIPE ZONE, AND TRENCH BACKFILL.


T-CUT ASPHALT DETAILS

DRAWING NO. 600

REVISED 12-16



SEAL THE AREA BETWEEN THE END OF THE CASING AND PIPE BY FORCING GROUT INTO THE SPACE AROUND THE PIPE AT THE DIMENSIONS SHOWN.

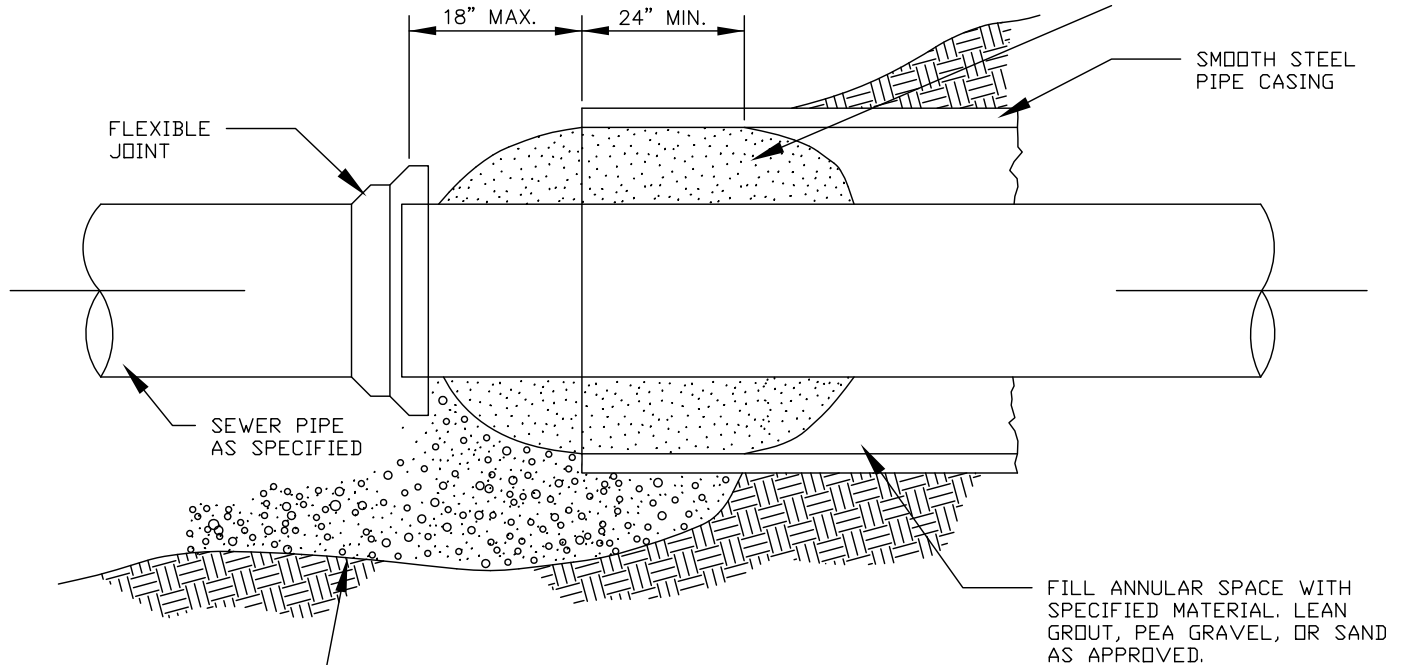

FILL BORE PIT WITH COMPACTED 3/4"-0 BACKFILL MATERIAL


PIPE SEAL DETAIL

BEGIN AT THE FAR END AND FILL BACK TOWARD THE INSERTION HOLE.
AIR VENT AND FILLING POINTS SHALL BE REMOVED PRIOR TO GROUT PLUGS BEING INSTALLED.

CASING PIPE:
6"-12" DIA.- 1/4" MIN. THICKNESS.
15"-24" DIA. - 5/16" MIN. THICKNESS.
OR AS SPECIFIED

NOTES:


1. PROVIDE PIPE NIPPLE AT TOP OF CASING, AT EACH END OF CASING OR AS SPECIFIED, FOR FILLING AND VERIFYING FILLING OPERATION. (MIN DIAMETER SIZE 4")
2. GROUT SHALL BE PUMPED TO FILL VOIDS AROUND THE CASING DURING THE INSTALLATION. ENGINEER DESIGN REQUIRED.

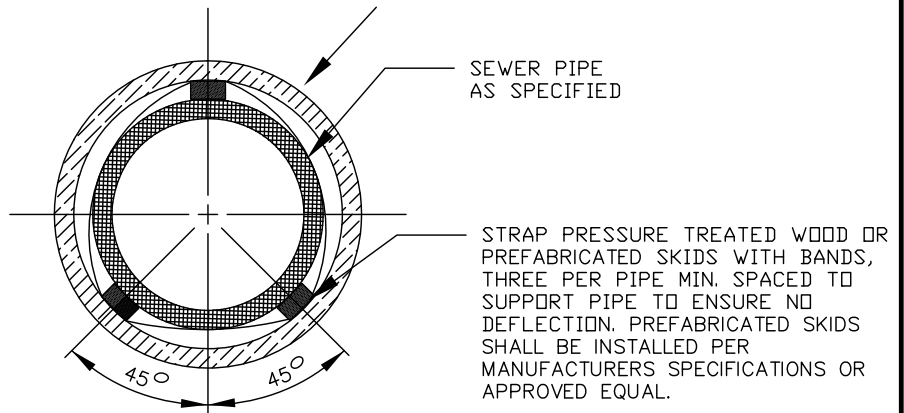

CASING SECTION

BORE DETAIL



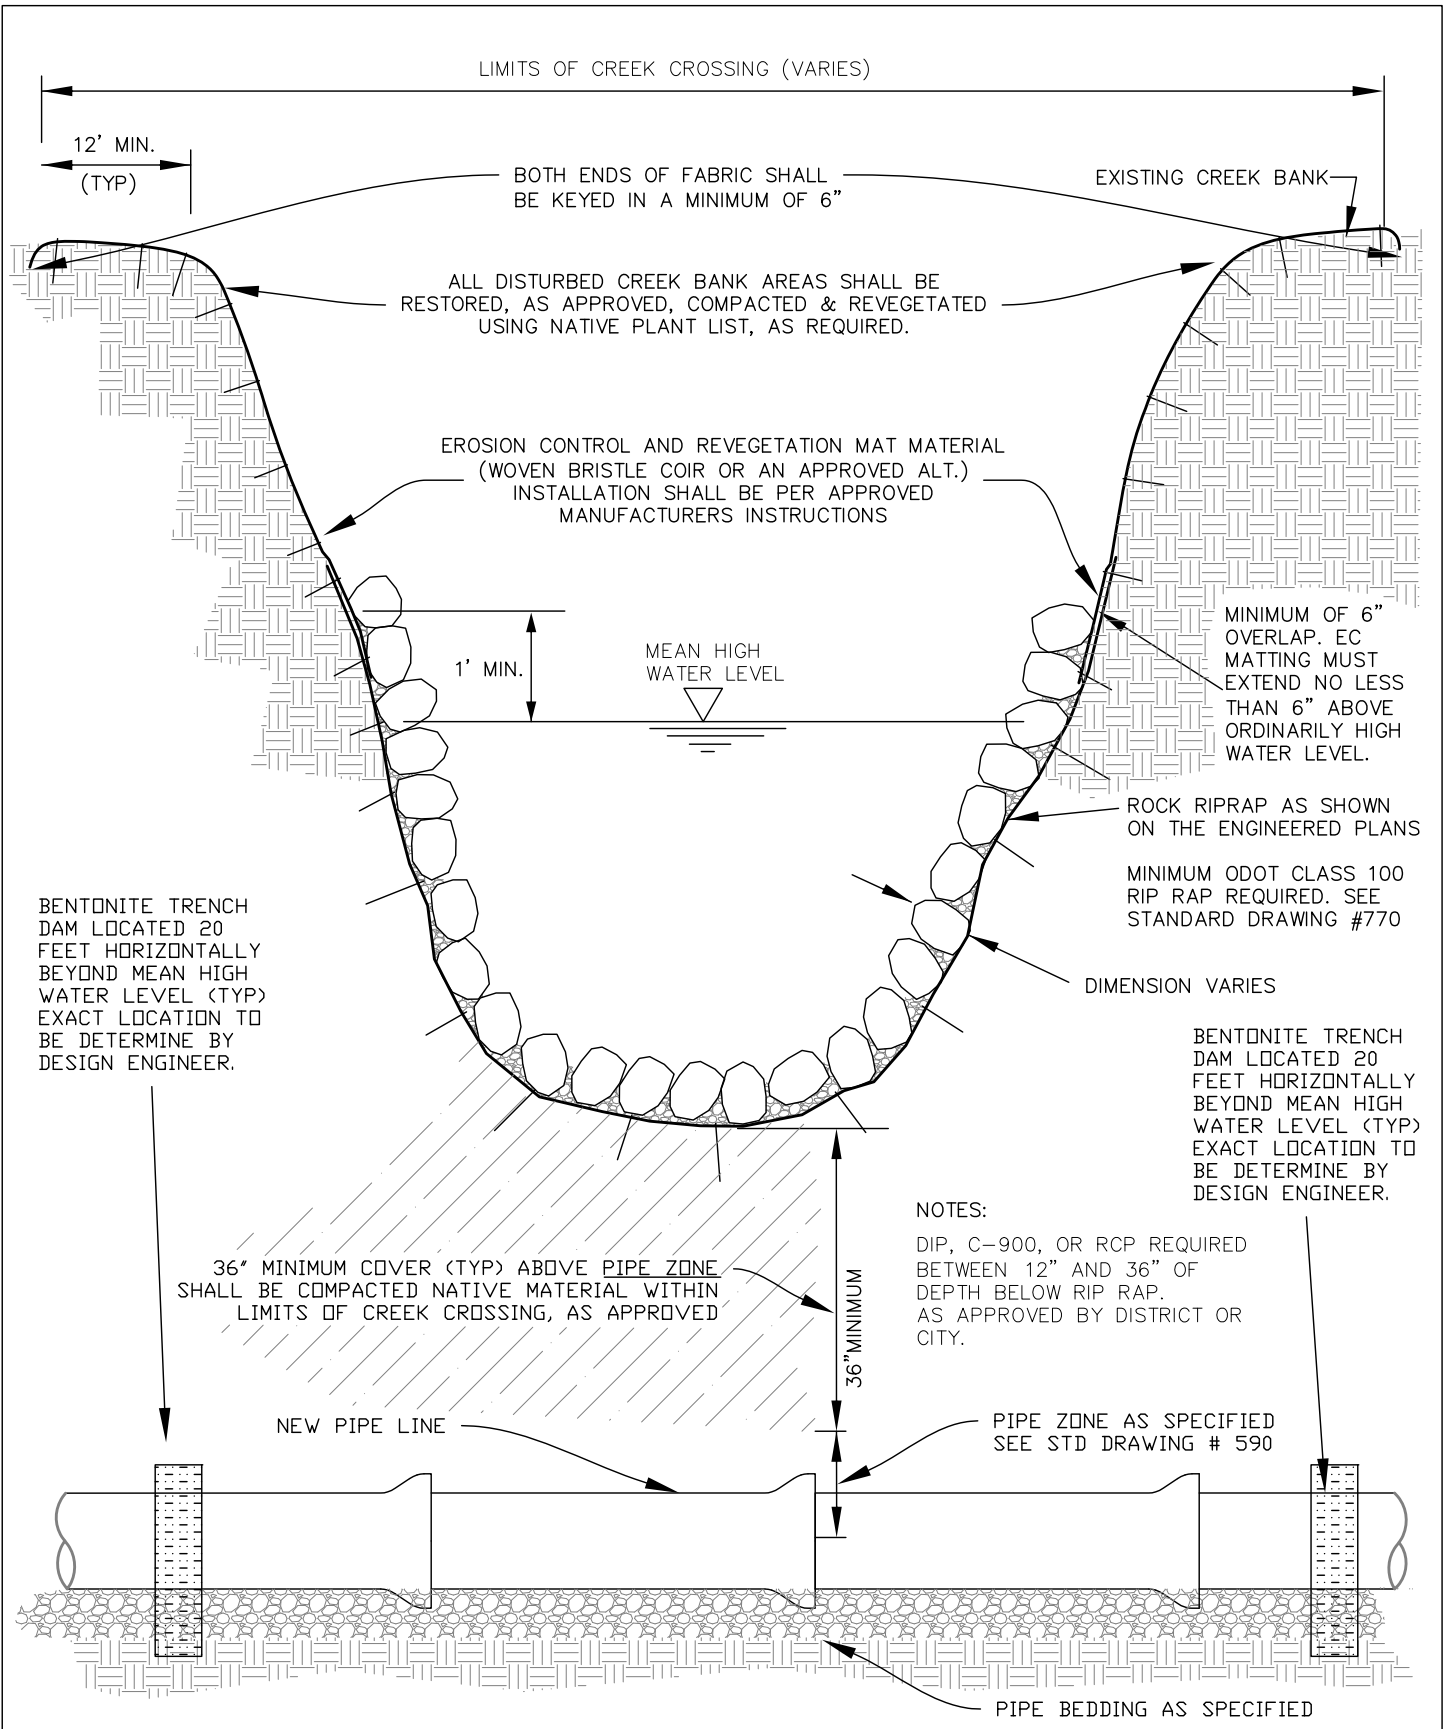

CREEK CROSSING RESTORATION

