



PLAN CURB CUT-OUT  
N.T.S.

ISOMETRIC CURB CUT-OUT  
N.T.S.

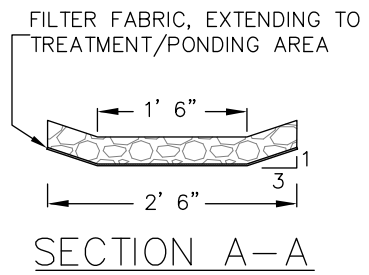

SECTION A-A

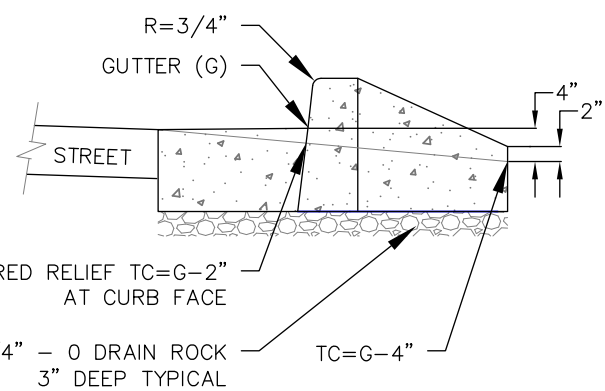

NOTES:

1. INFLOW STRUCTURE PER LOCAL JURISDICTION. CURB CUT OUTS NOT ALLOWED ON WASHINGTON COUNTY ROADS – USE MODIFIED CG-30 SEE DETAIL 403, FOR INLET STRUCTURE.
2. INFLOW STRUCTURE – CURB CUTOUT SHALL HAVE MINIMUM 2" DROP AT THE FLOW LINE LEADING TO THE SPLASH PAD, SEE DETAIL.
3. ENERGY DISSIPATER DRAIN ROCK: ROCK SIZE 4-1/2" – 2-1/2" OR SIZED BY DESIGN INFLOW. PLACE ROCK 6" DEEP BEHIND SPLASH PAD.
4. CURB PROFILE PER LOCAL JURISDICTION.
5. ENSURE THAT DOWNSTREAM CATCH BASINS ARE IN PLACE FOR HIGH FLOW CONVEYANCE.

<p>CURB CUT OUT</p>	<p>LIDA HANDBOOK</p>	
<p>DRAWING NO. 401</p>	<p>REVISED 05-16</p>	