



PLAN VIEW

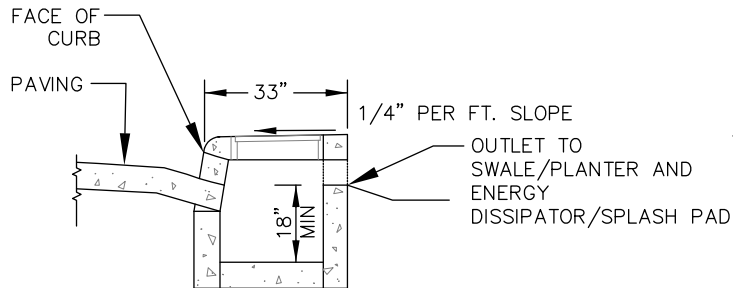

SECTION A-A
NON-SNOUT

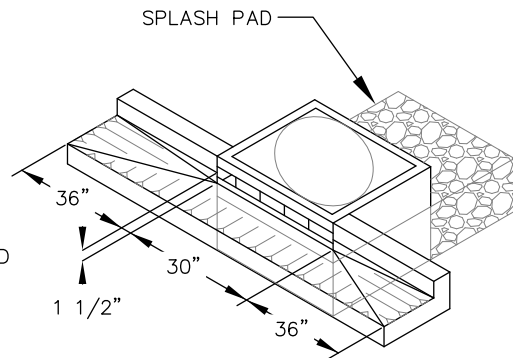

PERSPECTIVE VIEW
SHOWING DEPRESSED
GUTTER AT CURB INLET

NOTES:

1. ALL FABRICATED METAL PARTS SHALL BE NEW STRUCTURAL, ASTM A-36 STEEL, AND BE HOT-DIPPED GALVANIZED AFTER FABRICATION.
2. INSTALL STRUCTURE ON MINIMUM OF 8" OF 3/4" TO 0" COMPACTED BASE MATERIAL.
3. INSTALL ENERGY DISSIPATOR/SPLASH PAD AT OUTFALL OF STRUCTURE.

MODIFIED CG-30 INLET
WITH SUMP

DRAWING NO. 403

LIDA
HANDBOOK

REVISED 05-16

CleanWater Services